



**1. Hawthorne St (Southern Low Level) - Maximum Values for February 2014**

Parameter	EPP Goal	Averaging Period	Maximum Value	Wind Direction	Date & Time
NO <sub>2</sub>	120 ppb	1 hour	23 ppb	133°	18/02/2014 07:00
CO	9 ppm	8 hours	0.27 ppm	43°	13/02/2014 23:00
PM <sub>2.5</sub>	25 µg/m <sup>3</sup>	24 hours	17.2 µg/m <sup>3</sup>	59°	13/02/2014
PM <sub>10</sub>	50 µg/m <sup>3</sup>	24 hours	28.8 µg/m <sup>3</sup>	59°	13/02/2014


**PM2.5, Daily average**  
Hawthorne Street

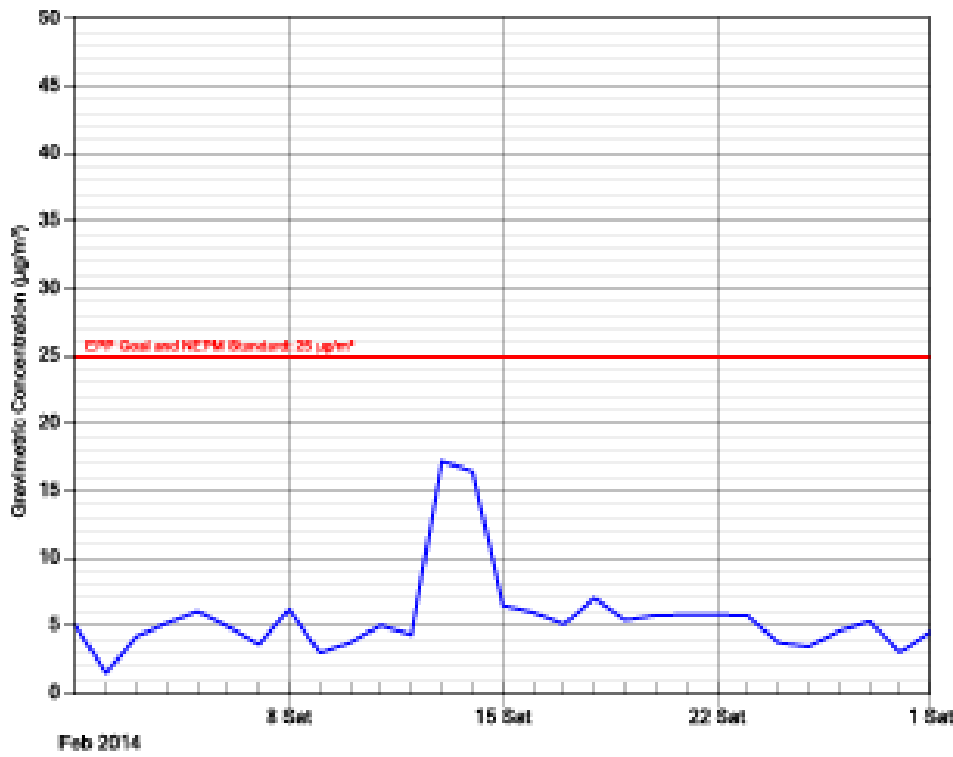


**PM10, Daily average**  
Hawthorne Street

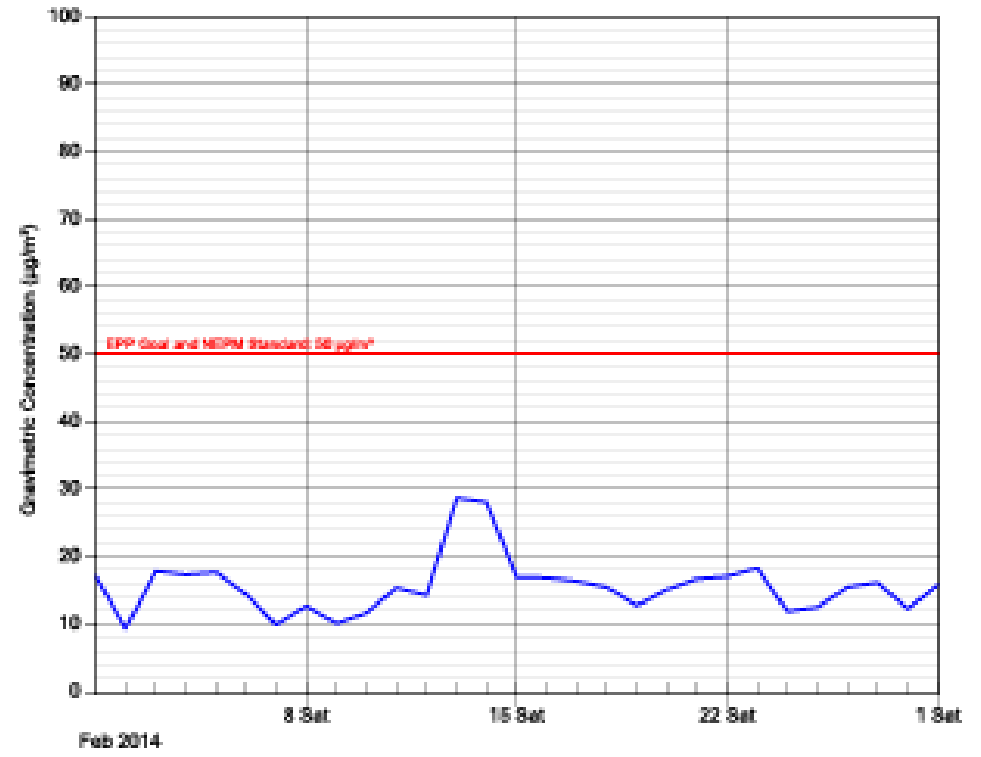

**NO2 graph, 1 hour average**  
Hawthorne Street

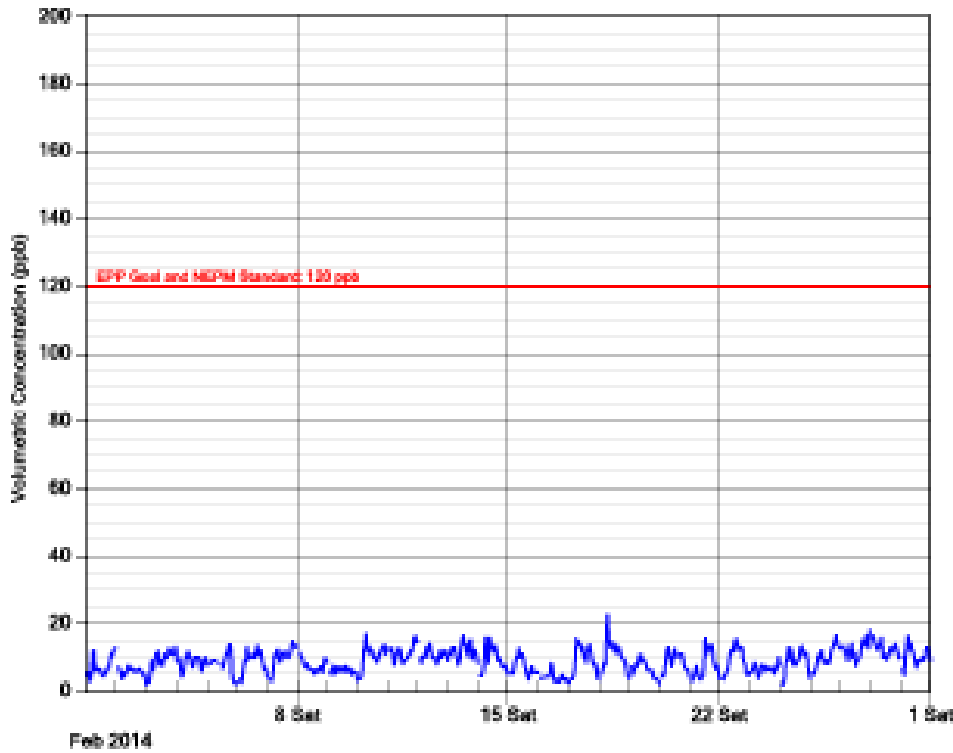





**CO, 8 hour rolling average**  
Hawthorne Street

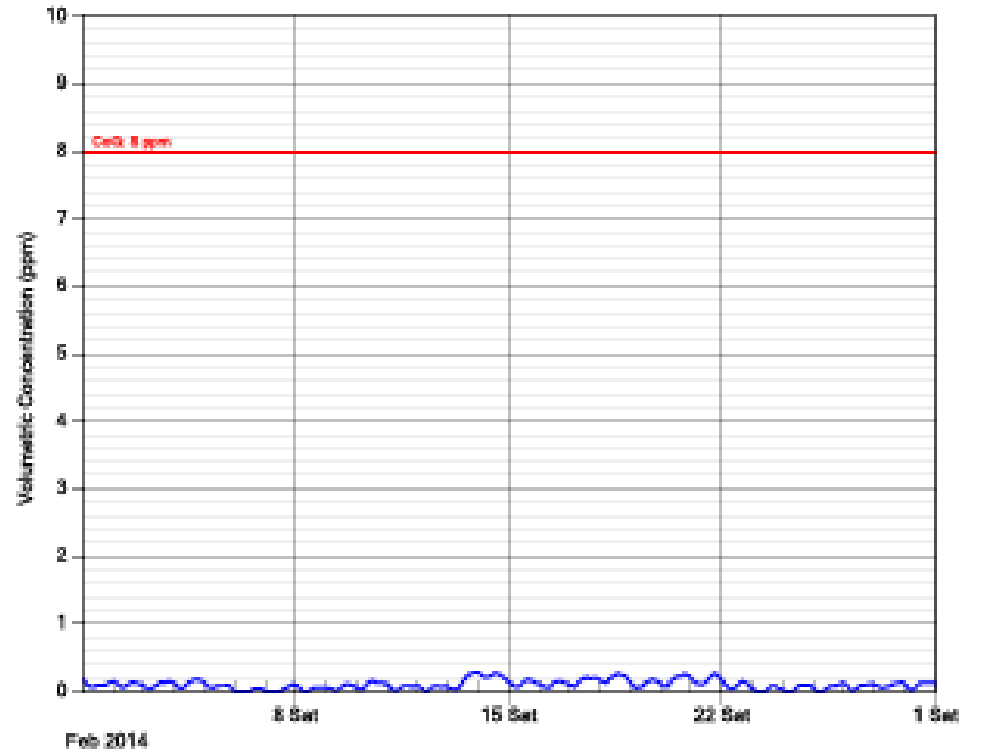

**Exceedances:** No exceedances for February 2014

**2. Landcentre (Southern High Level) – Maximum Values for February 2014**

Parameter	EPP Goal	Averaging Period	Maximum Value	Wind Direction	Date & Time
NO <sub>2</sub>	120 ppb	1 hour	20 ppb	349°	14/02/2014 06:00
CO	9 ppm	8 hours	0.23 ppm	53°	14/02/2014 12:00
PM <sub>2.5</sub>	25 µg/m <sup>3</sup>	24 hours	16.1 µg/m <sup>3</sup>	360°	14/02/2014
PM <sub>10</sub>	50 µg/m <sup>3</sup>	24 hours	29.9 µg/m <sup>3</sup>	360°	14/02/2014

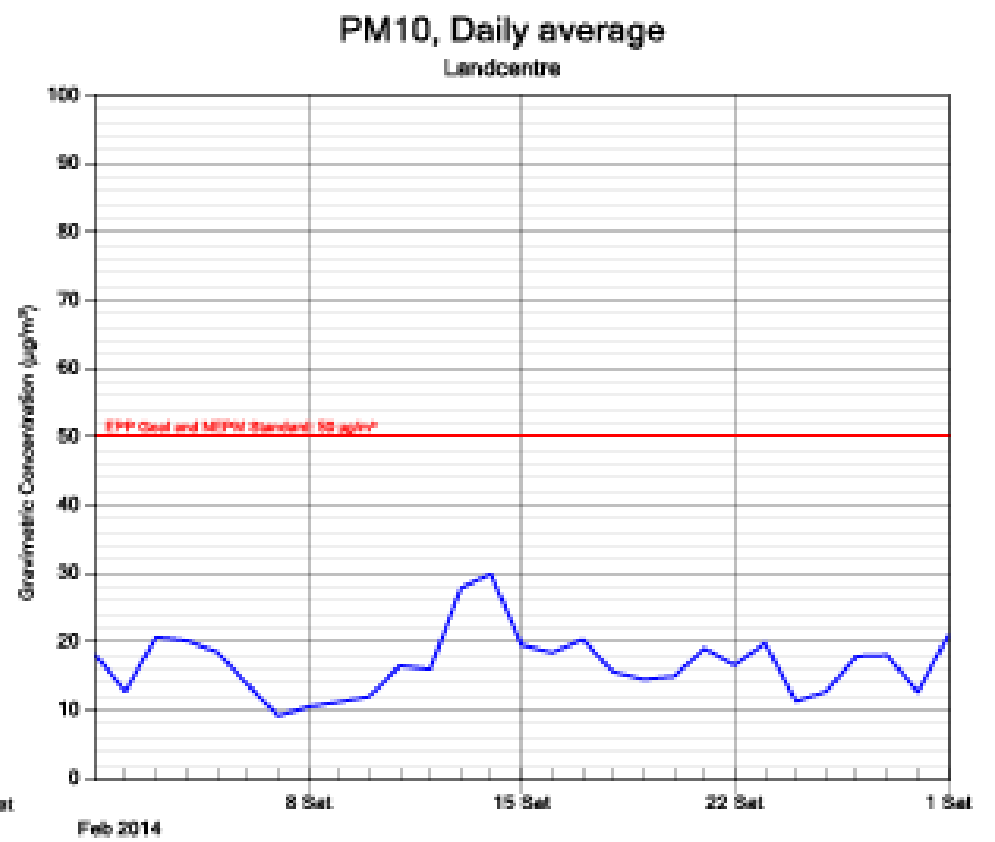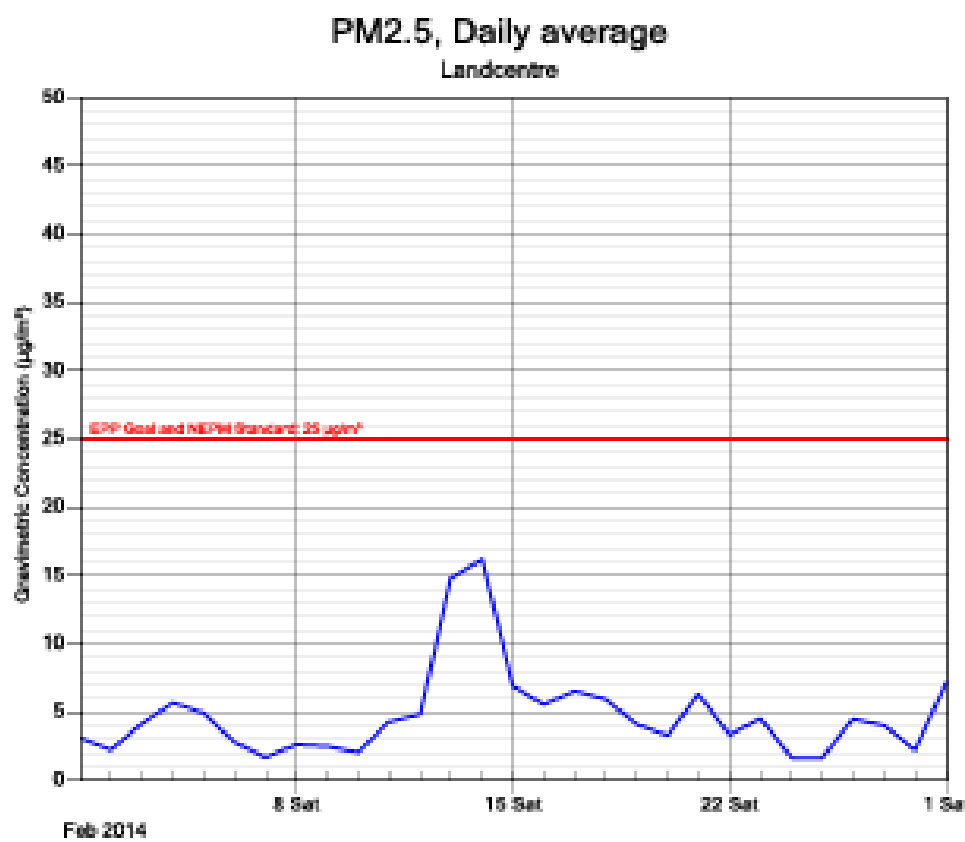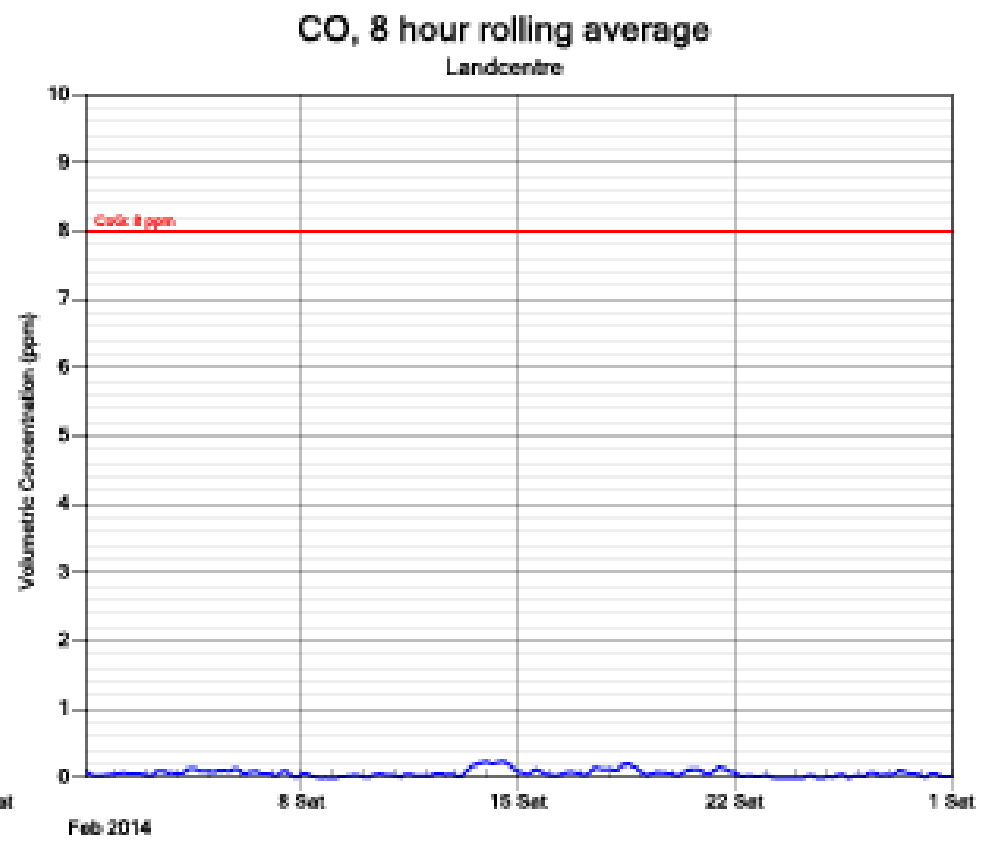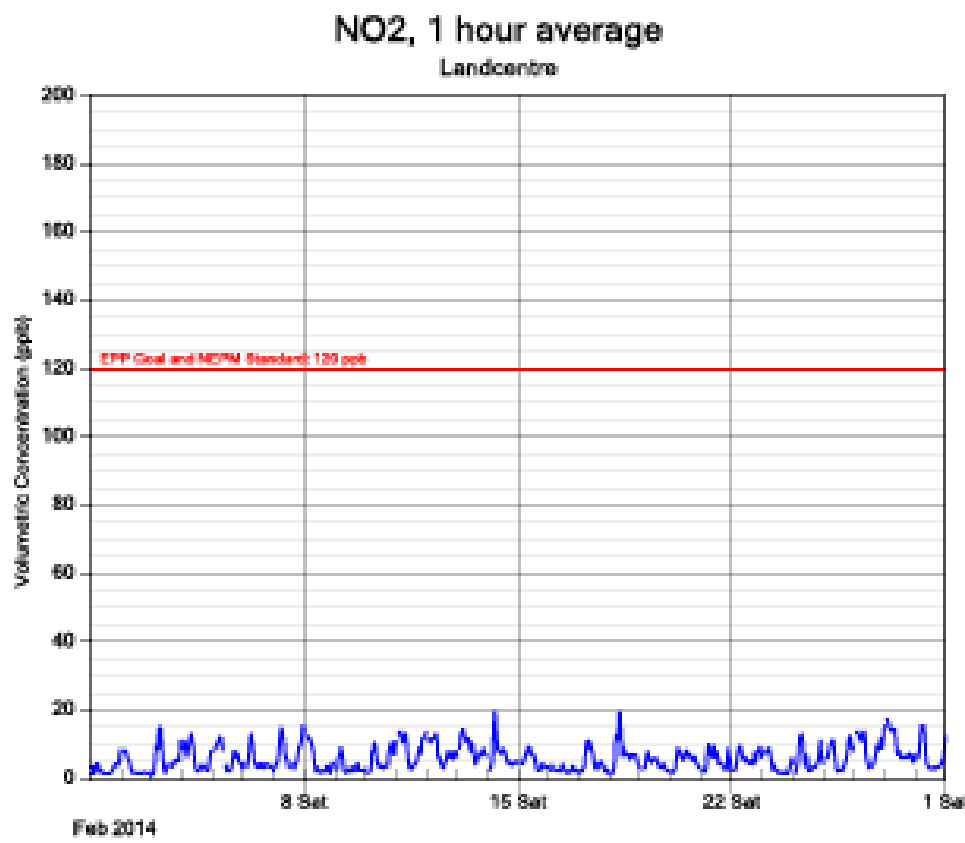


**Exceedances:** No exceedances for February 2014


**3. Northey St (Northern Low Level)– Maximum Values for February 2014**

Parameter	EPP Goal	Averaging Period	Maximum Value	Wind Direction	Date & Time
NO <sub>2</sub>	120 ppb	1 hour	17 ppb	42°	26/02/2014 21:00
CO	9 ppm	8 hours	0.31 ppm	322°	14/02/2014 01:00
PM <sub>2.5</sub>	25 µg/m <sup>3</sup>	24 hours	14.0 µg/m <sup>3</sup>	66°	13/02/2014
PM <sub>10</sub>	50 µg/m <sup>3</sup>	24 hours	23.9 µg/m <sup>3</sup>	66°	13/02/2014


**NO<sub>2</sub>, 1 hour average**  
Northey Street

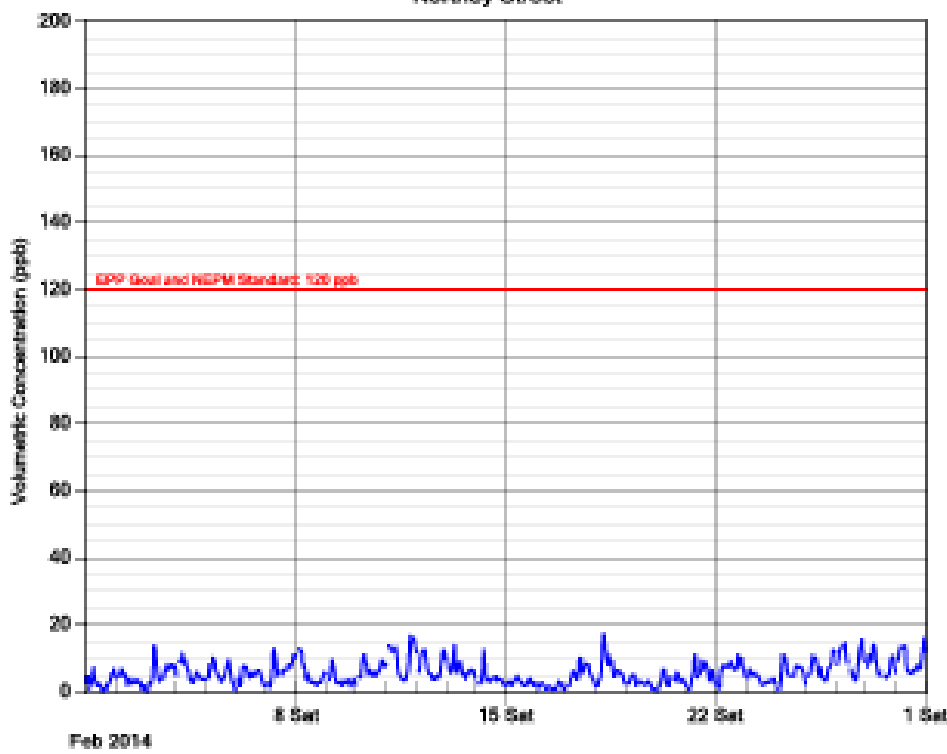


**CO, 8 hour rolling average**  
Northey Street

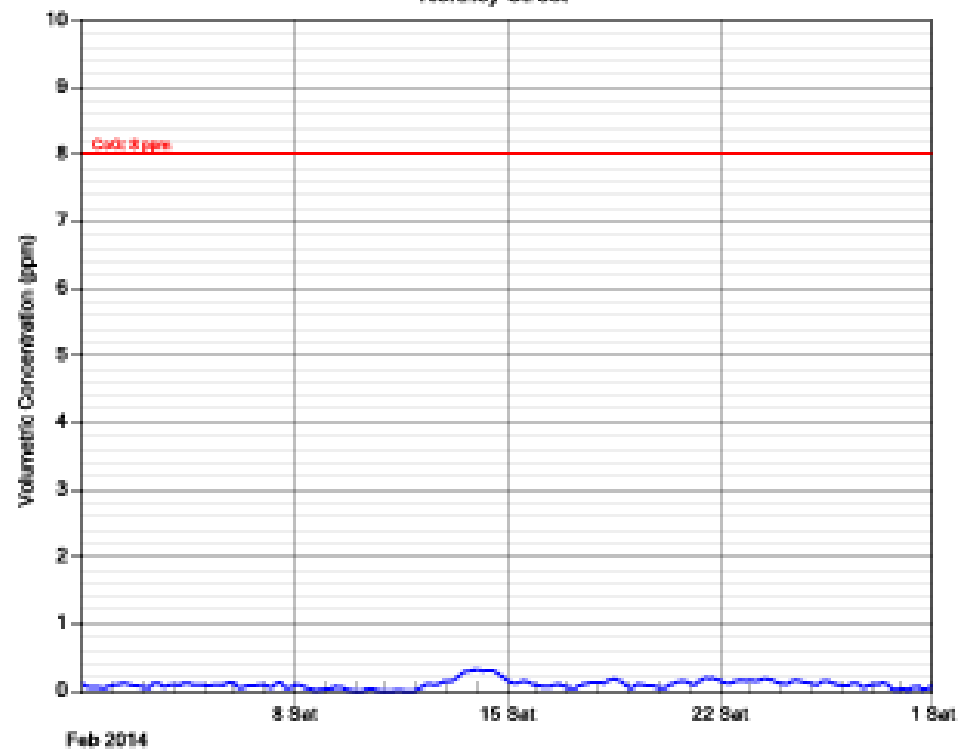

**PM<sub>2.5</sub> Daily average**  
Northey Street

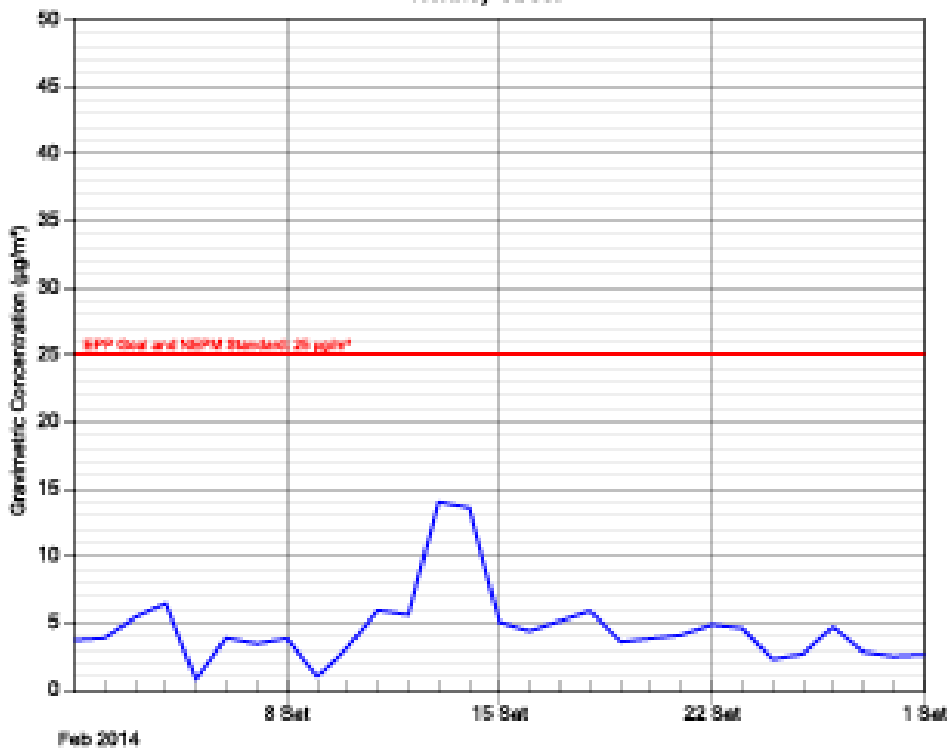

**PM<sub>10</sub> Daily average**  
Northey Street

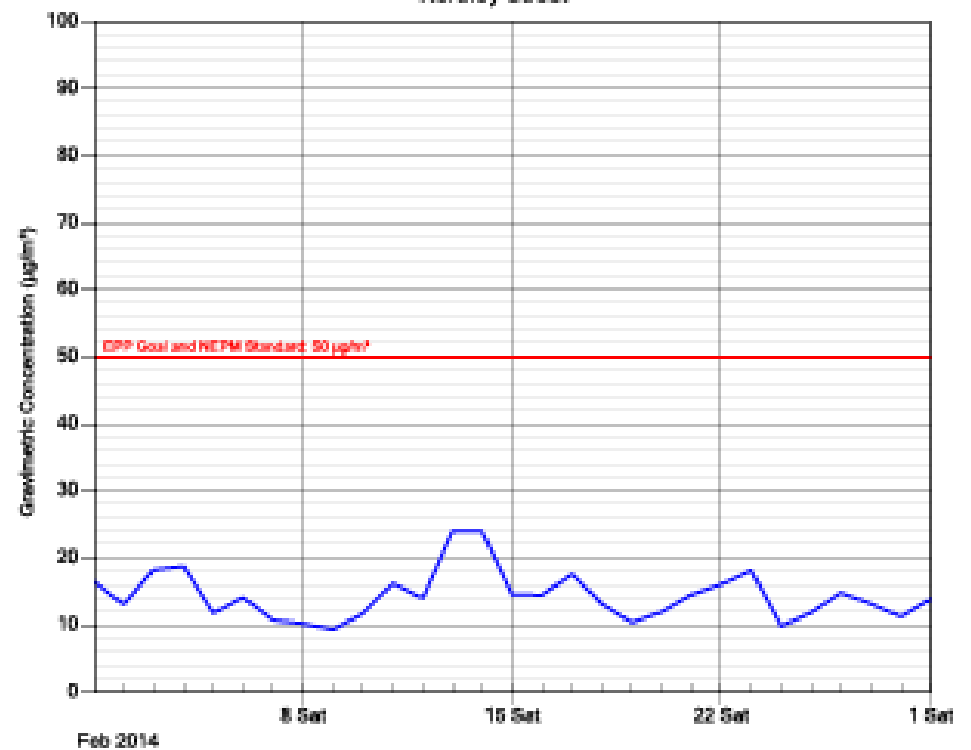


**Exceedances:** No exceedances for February 2014


**4. Royal Brisbane Hospital (Northern High Level) – Maximum Values for February 2014**

Parameter	EPP Goal	Averaging Period	Maximum Value	Wind Direction	Date & Time
NO <sub>2</sub>	120 ppb	1 hour	18 ppb	110°	27/02/2014 05:00
CO	9 ppm	8 hours	0.34 ppm	193°	04/02/2014 08:00
PM <sub>2.5</sub>	25 µg/m <sup>3</sup>	24 hours	17.1 µg/m <sup>3</sup>	5°	14/02/2014
PM <sub>10</sub>	50 µg/m <sup>3</sup>	24 hours	28.1 µg/m <sup>3</sup>	5°	14/02/2014


**NO<sub>2</sub>, 1 hour average**  
Royal Brisbane Hospital

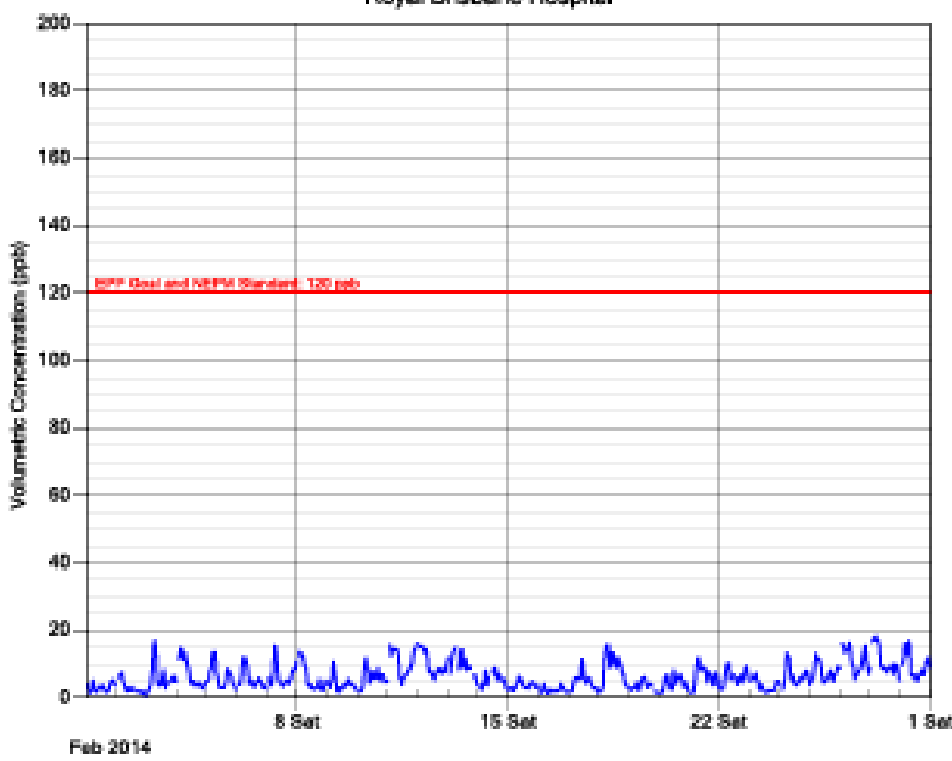


**CO, 8 hour rolling average**  
Royal Brisbane Hospital

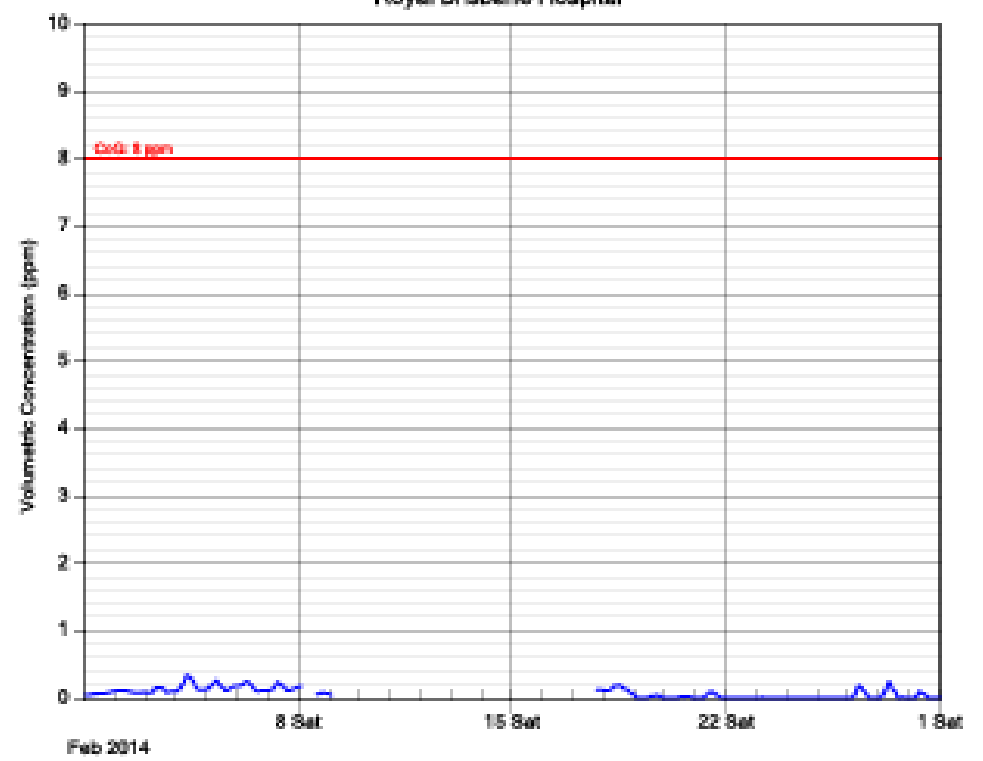

**PM<sub>2.5</sub> Daily average**  
Royal Brisbane Hospital

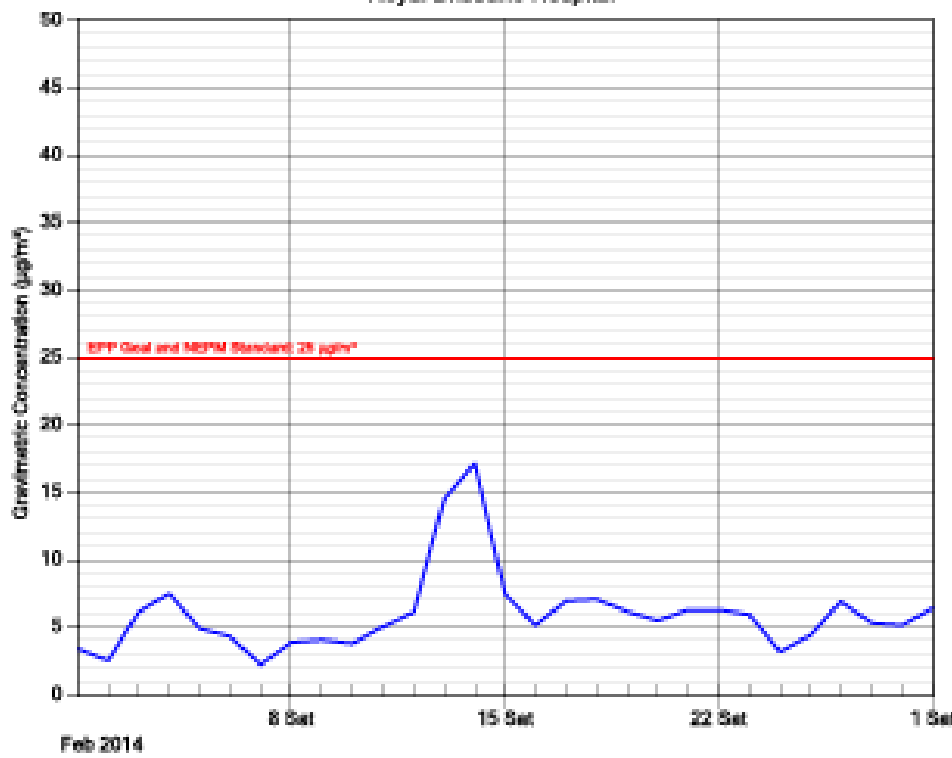

**PM<sub>10</sub> Daily average**  
Royal Brisbane Hospital

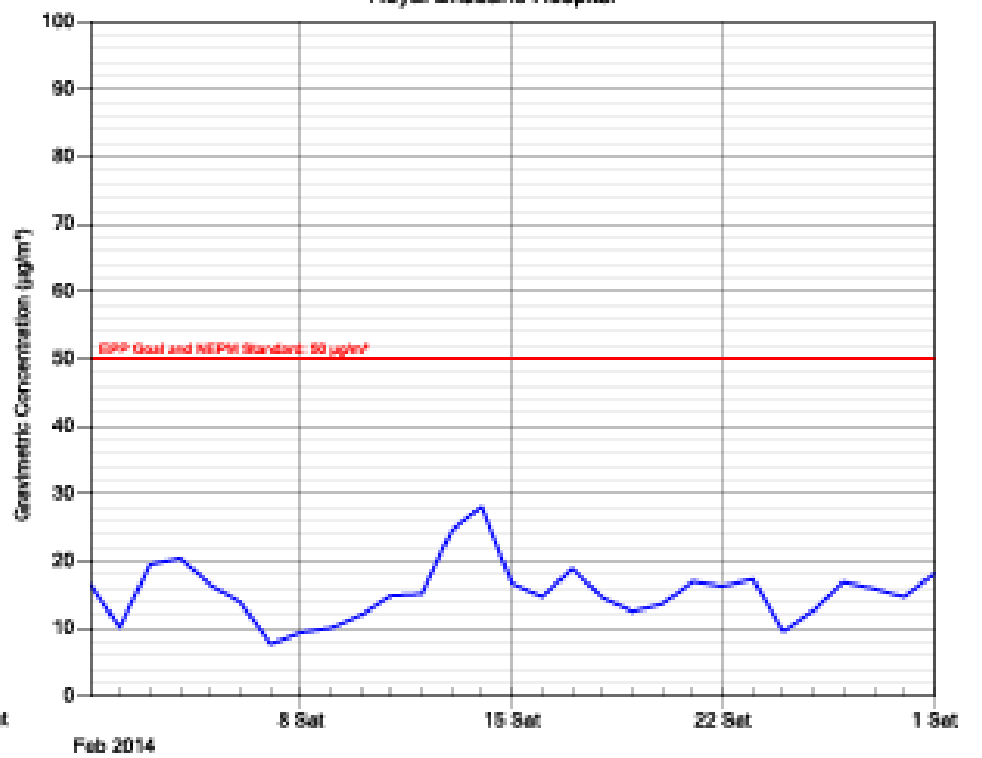

**Exceedances:** No exceedances for February 2014